



Hays CISD

21003 IH 35
Kyle, Texas 78640
512-268-2141 ext. 46035


ADDENDUM # 1

Date: November 15, 2023

BID #: 27-102303AS Propane Fueling System

Opening Date: December 4, 2023

1. Please provide the suggested location at Umland Transportation Center: where HCISD plans to place the fueling equipment. See below. The Purple circle is first option. Red circle and blue driveway is option two.

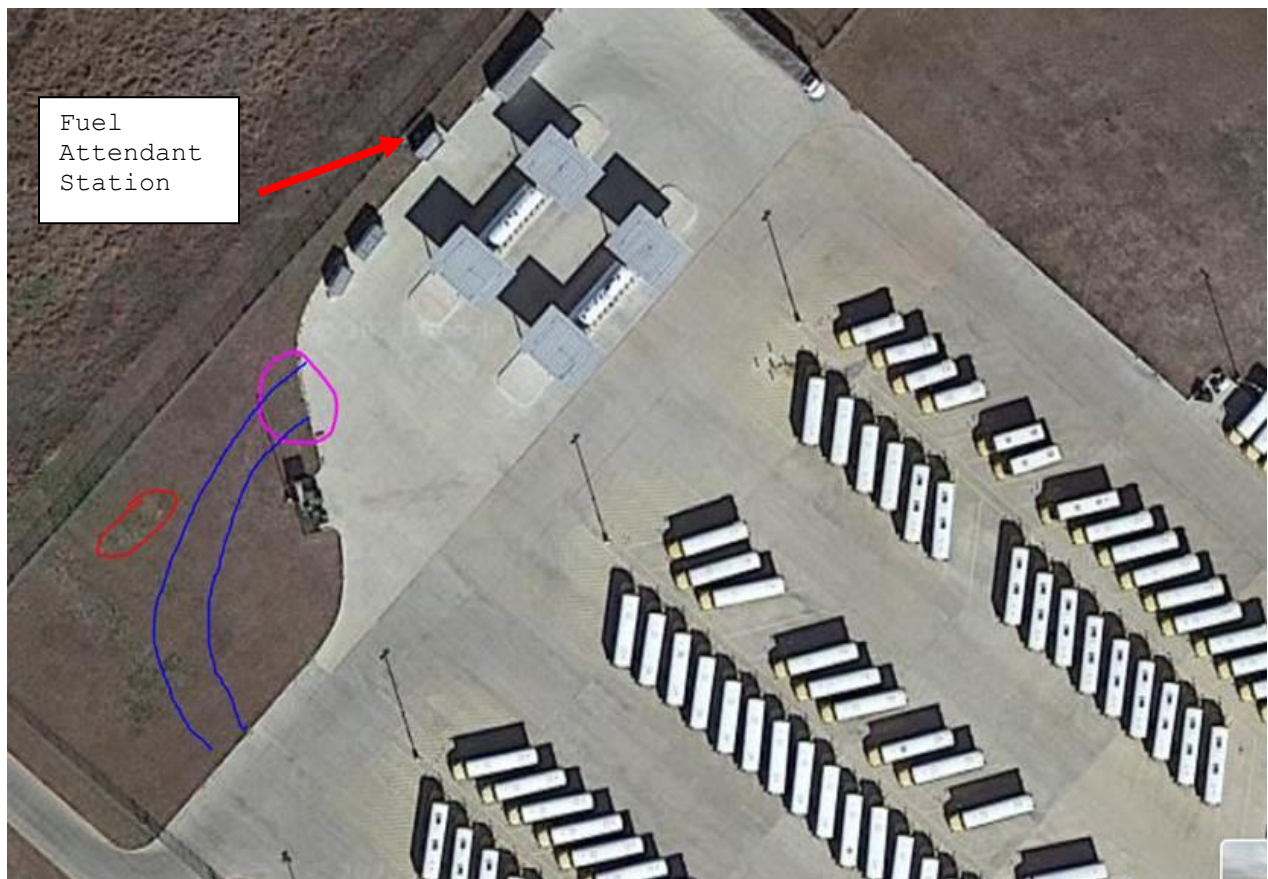

2. Is the location and conduit run, required to trench through concrete or asphalt? During the site visit, it was determined that a fuel attendant station would supply power. You would have to dig through dirt.

3. Is the power being provided: single phase or three phase (230V or 460V)? *The fuel attendant station, is set for 230V. However, if that needs to be upgraded please provide pricing.*
4. What is the expected installation date? *Please refer to section 12 - description of work.*
5. How did the school arrive at 100,00 estimated gallons with only 15 LP buses? *Actual is about 40,000 gallons. However, to account of possible expansion of fleet. Also, the district does not run the buses all year round.*
6. Will these questions (and others to follow) be answered prior to the deadline of 11/30/23. *Yes. As questions come in we are turning them around. No additional time will be provided. This timeline has to be meet to get this on the January Board Agenda.*
 - a. With the answers being provided by the 30th and the BID is due 12/4/23 - that only gives the responders, one (1) day to pull all the data and get it approved by our company.
This will not be enough sufficient TIME to respond accordingly.

Anston Shackley
Buyer

In the submission of the response, vendor must acknowledge receipt of this addendum. Otherwise this offer may not be given consideration. Vendor may acknowledge receipt on face of response or by returning one copy of this notice.

Signature of Bidder

Printed Name

Company Name